
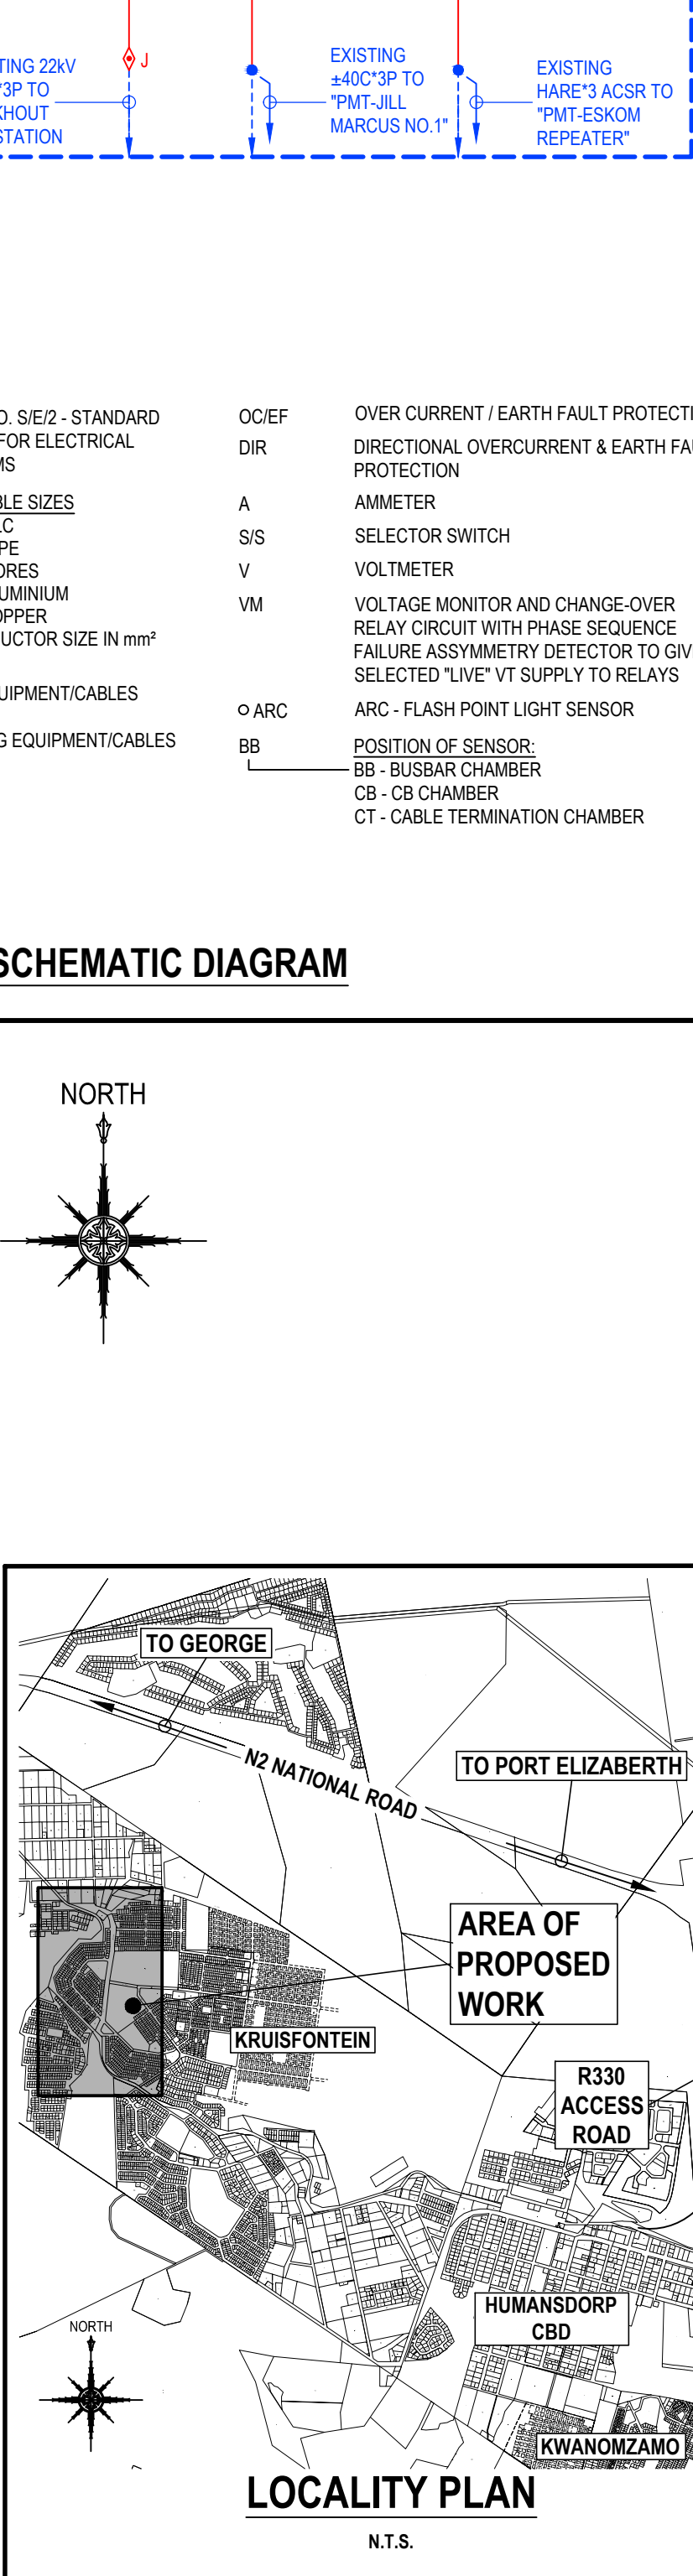
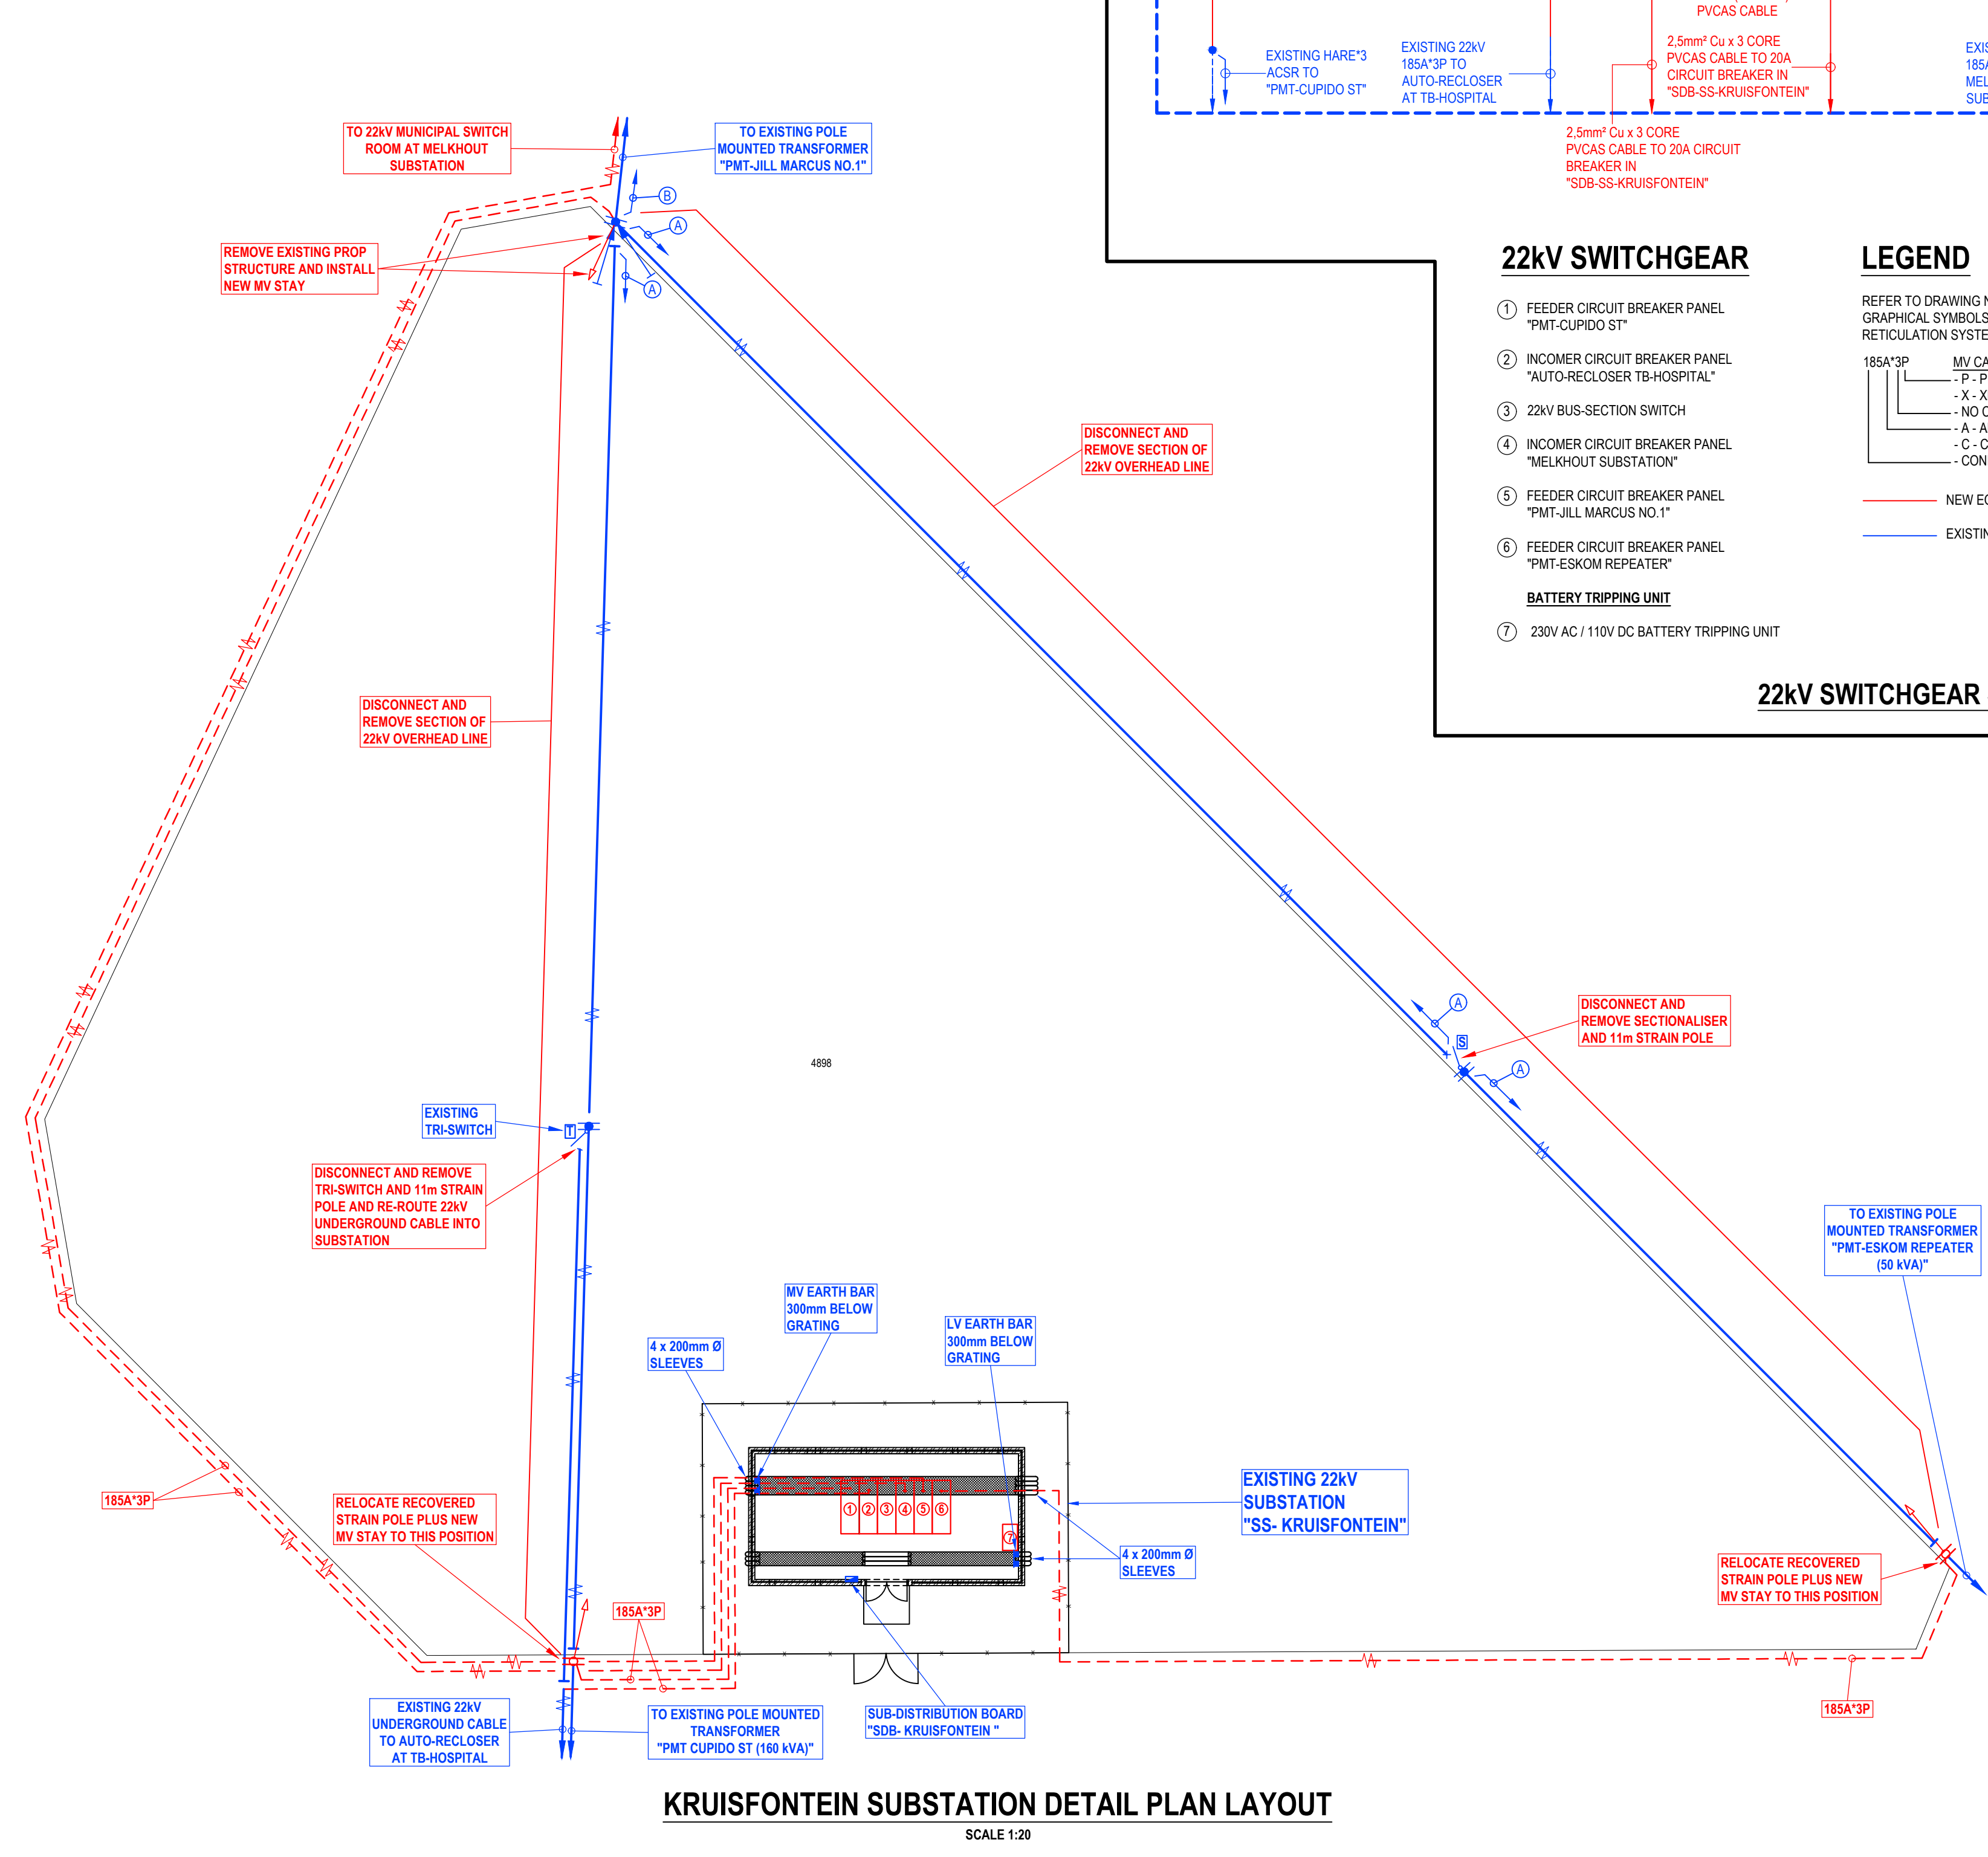
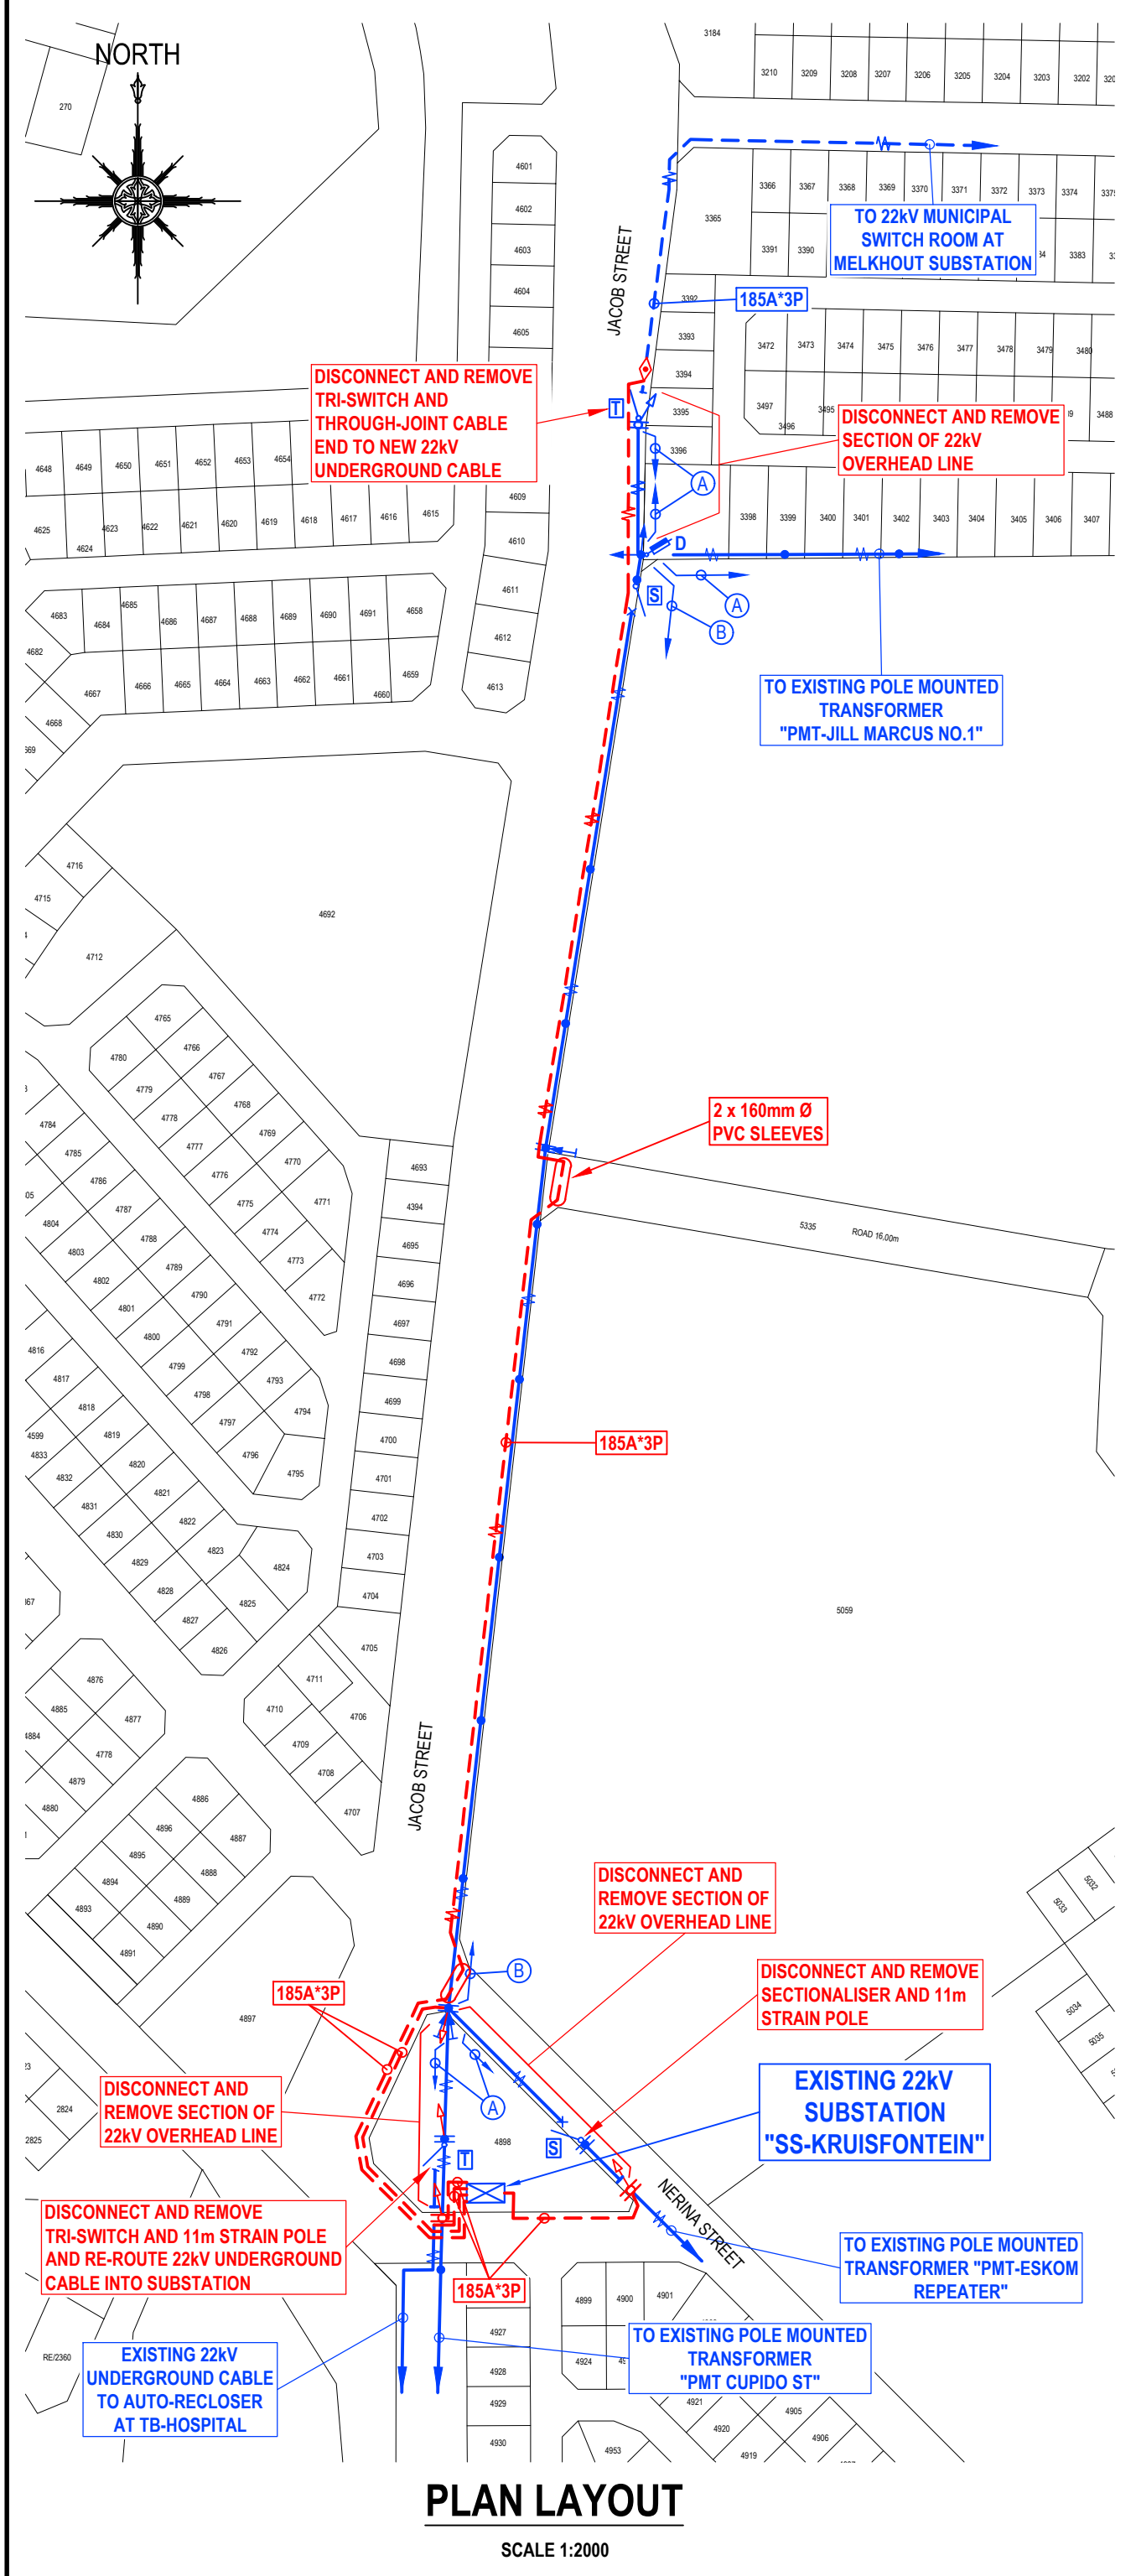
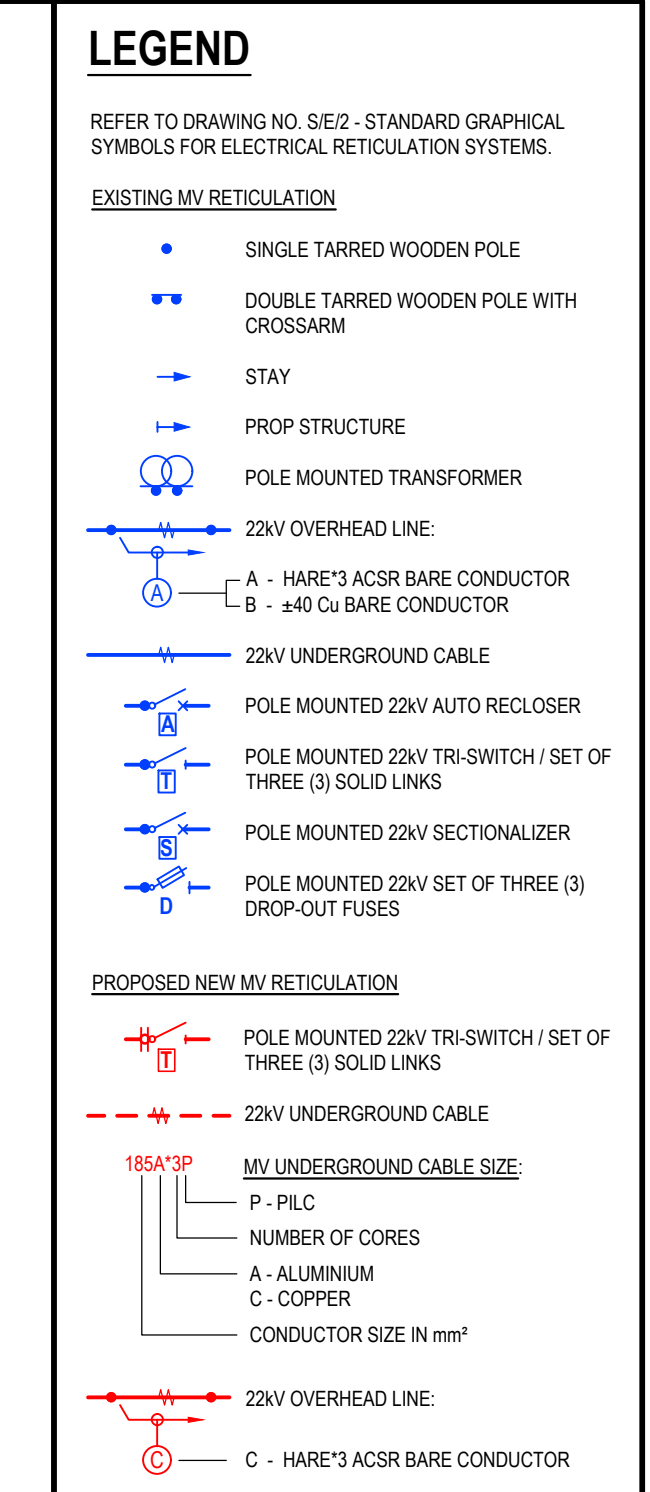
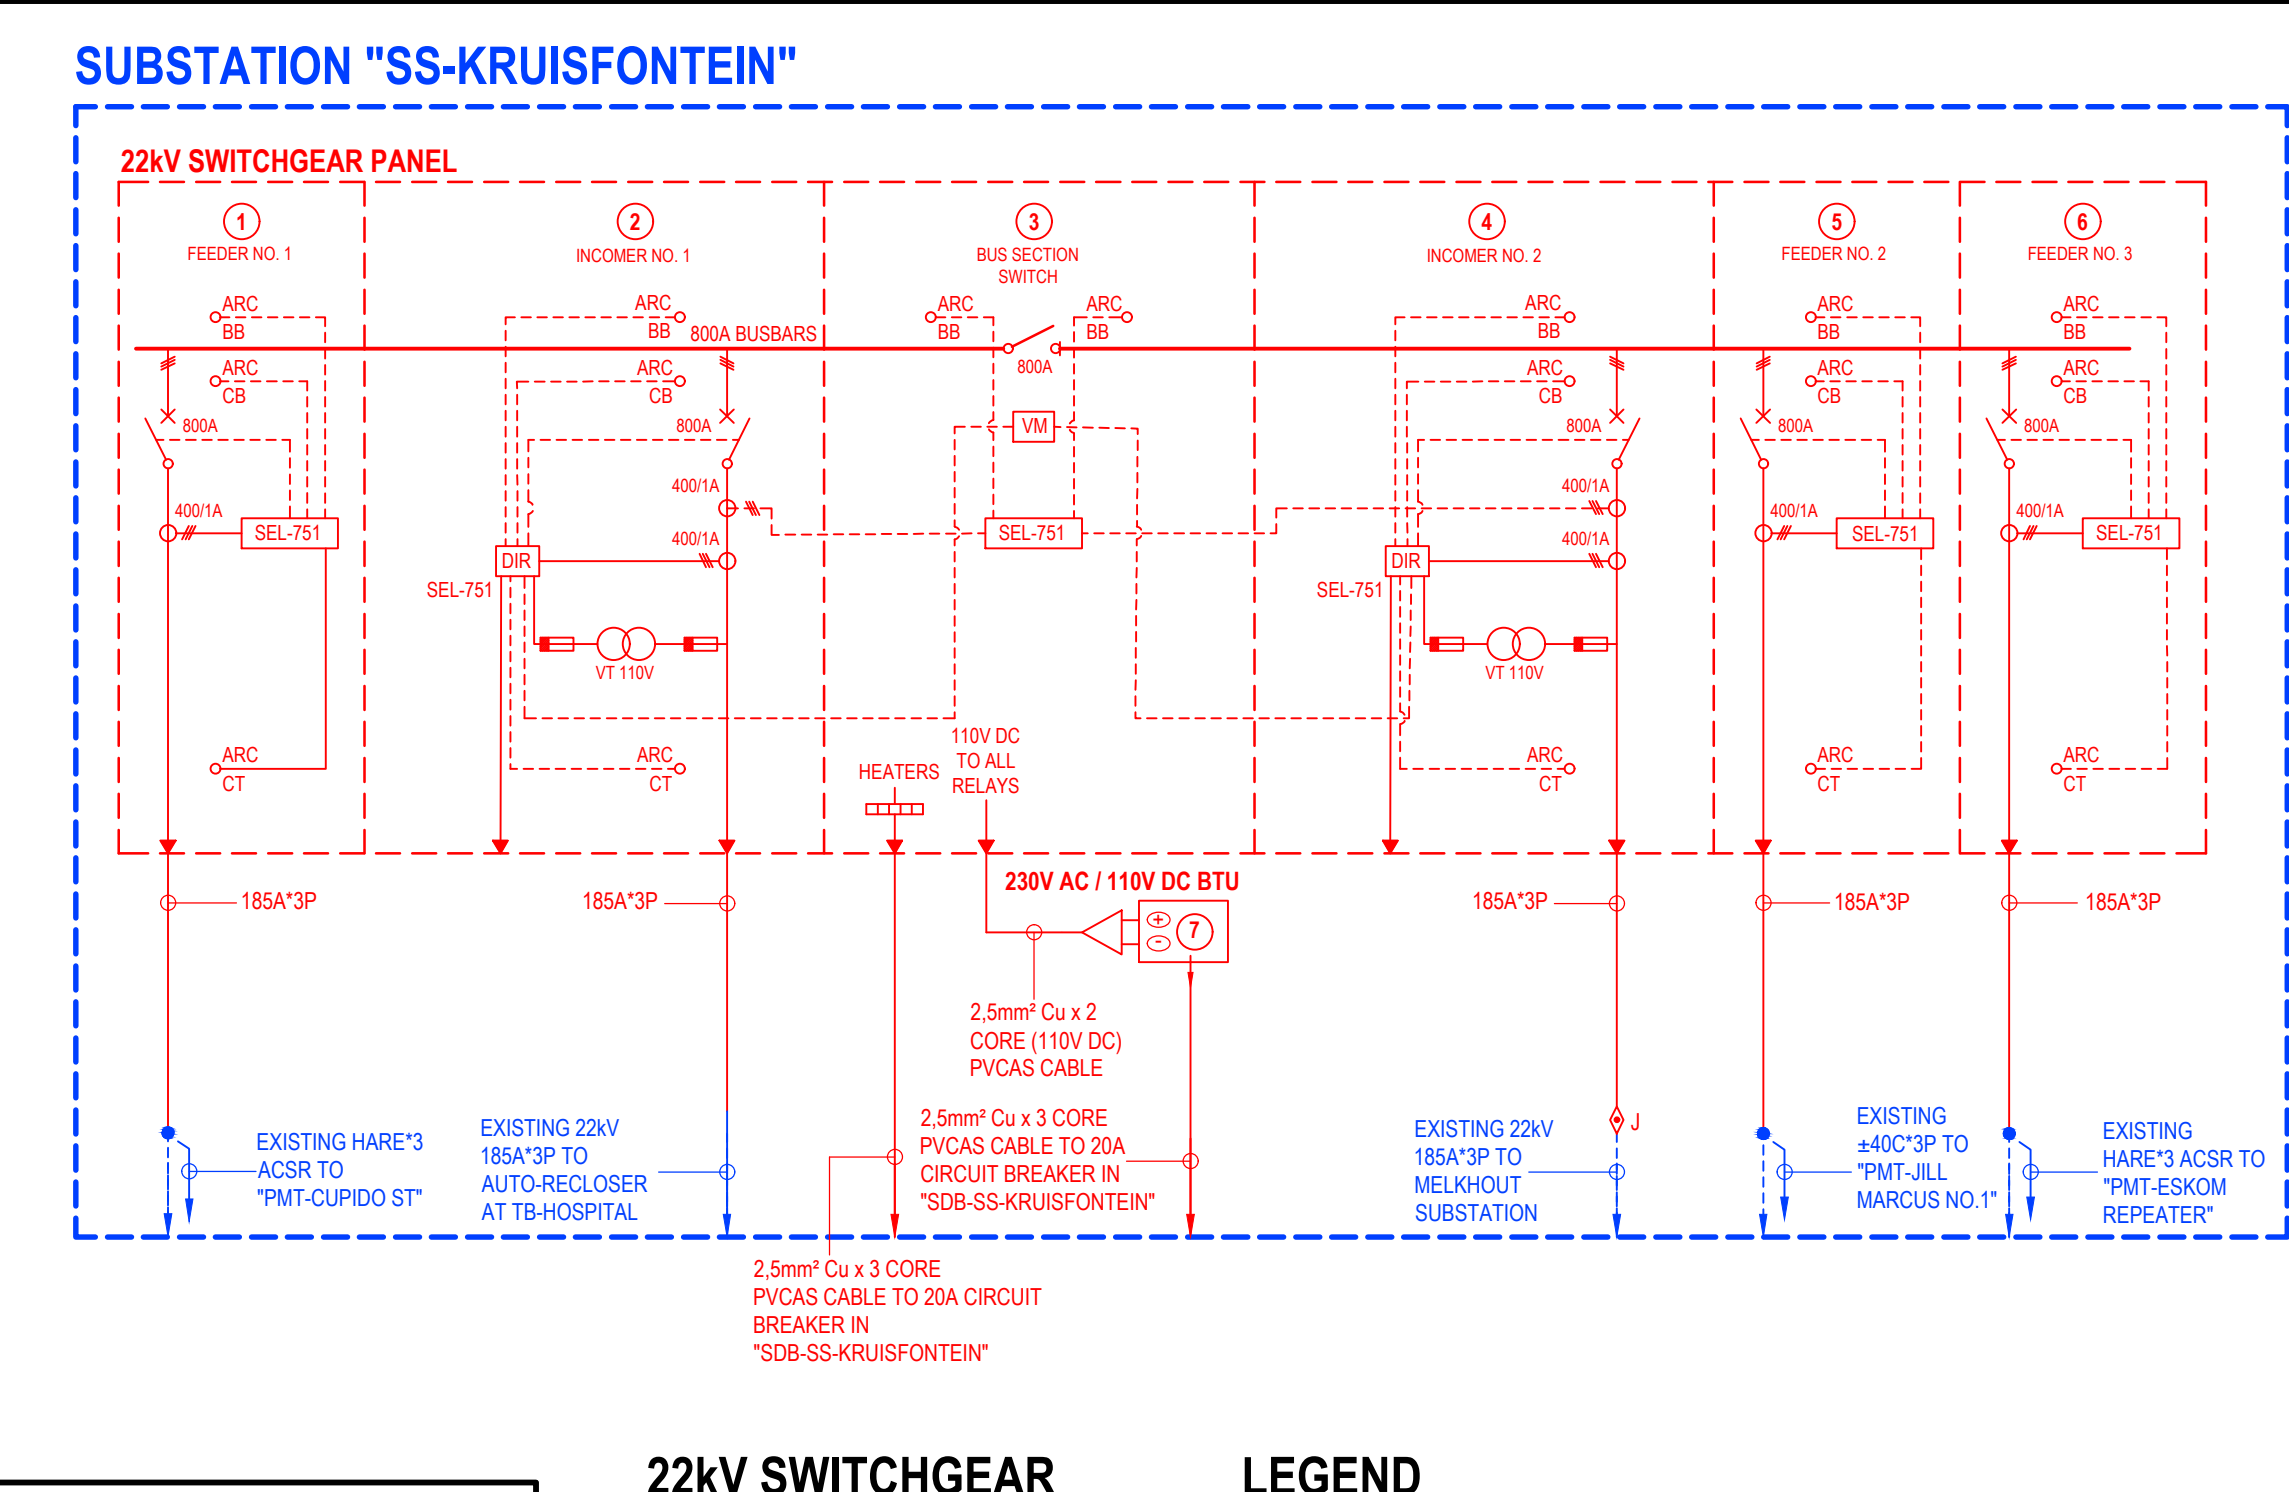
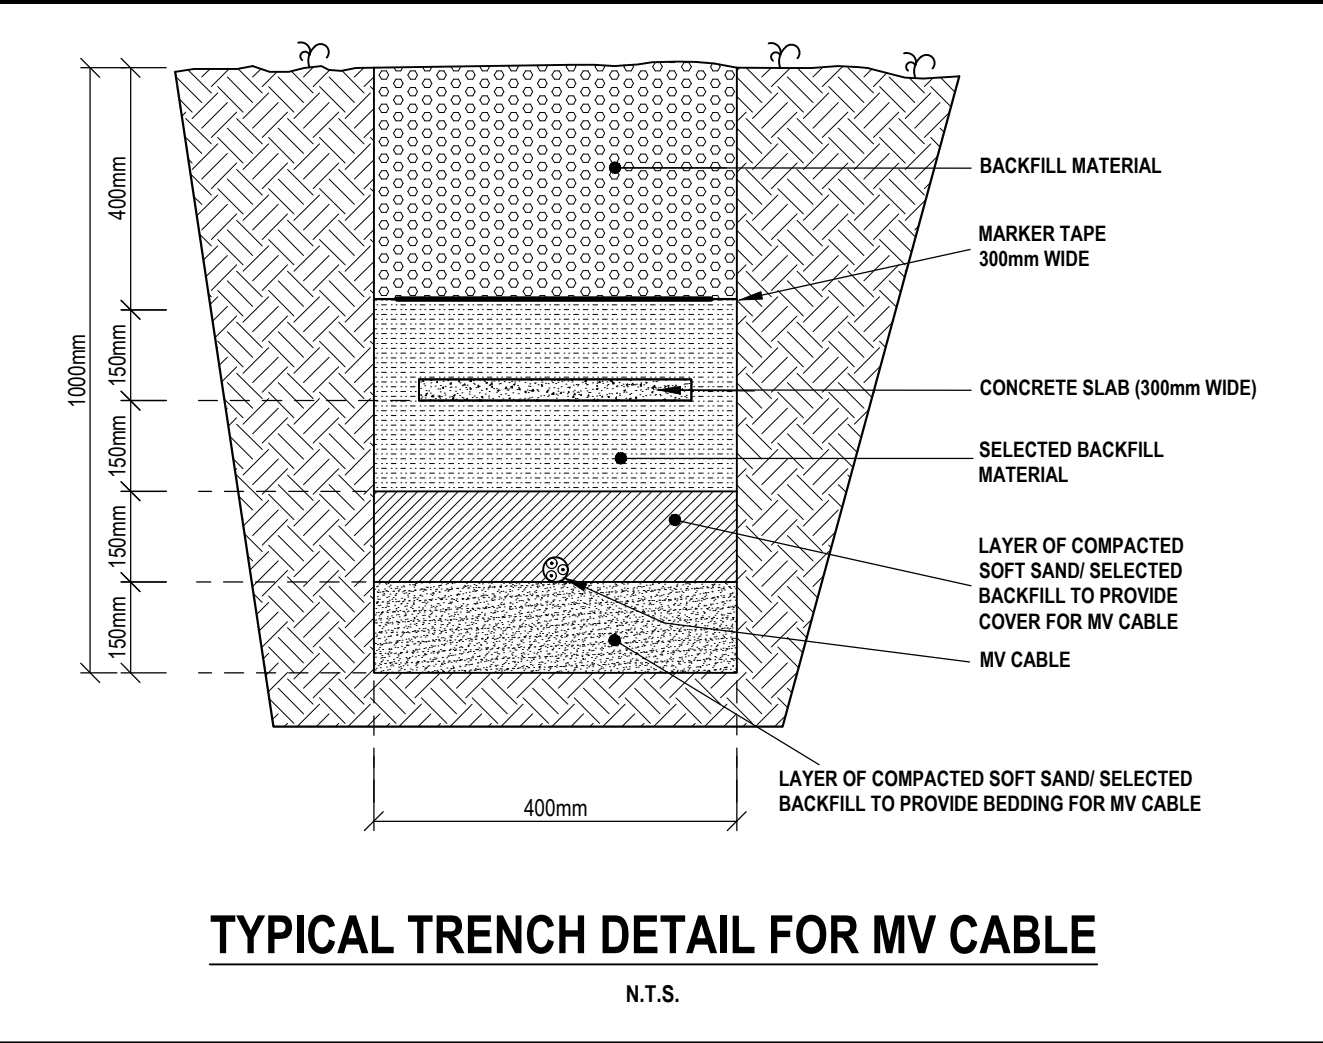


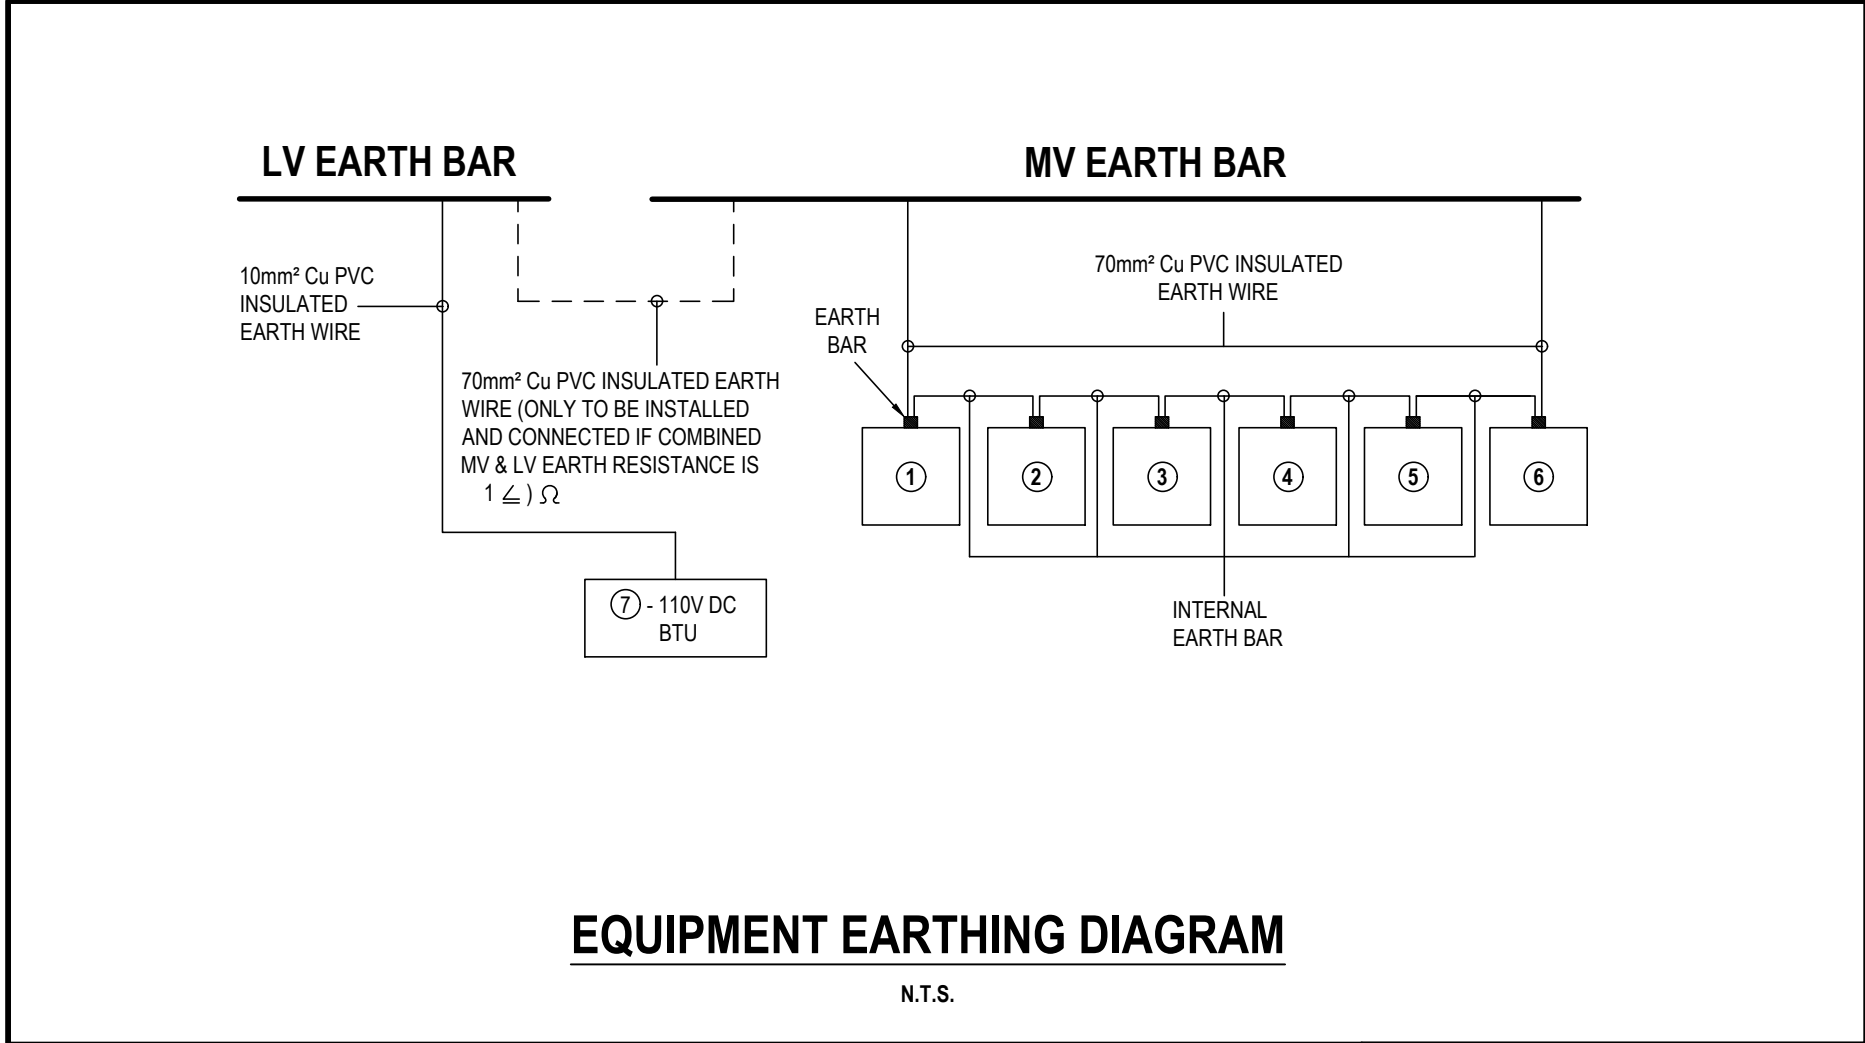

NOTES

- MV IN THIS CASE IS 22000 VOLT.
- UNDERGROUND CABLE ROUTES SHOWN ARE PROVISIONAL AND WILL BE DETERMINED ON SITE IN CONJUNCTION WITH THE ENGINEER.
- UNDERGROUND CABLES TO BE CO-ORDINATED WITH ALL EXISTING SEWER AND WATER PIPE LINE INSTALLATIONS.
- MINIMUM DISTANCE BETWEEN ERF BOUNDARIES AND NEW 22kV CABLE TO BE 500mm.
- WHERE TWO OR MORE MV CABLES ARE LAID NEXT TO EACH OTHER, A MIN. DISTANCE OF 300mm SHALL BE MAINTAINED BETWEEN THEM.

No.	DATE	DRAWN	DESCRIPTION
REVISIONS			

COPYRIGHT, ALL RIGHTS RESERVED.

NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM WITHOUT PERMISSION IN WRITING FROM THE AUTHOR.

THIS DRAWING IS TO BE USED FOR THE ENGINEERING SERVICE DEPICTED ONLY.

ELECTRICAL

KOUGA MUNICIPALITY

cmb

CLINKSCALES MAUGHAN-BROWN

CONSULTING ELECTRICAL ENGINEERS

PORT ELIZABETH GEORGE GATE TOWN

EAST LONDON BROWNSBURGH

CLINKSCALES MAUGHAN-BROWN (Pty) Ltd. REGD. ENGINEERS

PROJECT

BULK INFRASTRUCTURE WORK AND ELECTRIFICATION OF 200 HOUSES AT KRUISFONTEIN IN HUMANSDORP (DMRE WORK 2021/22)

DRAWING TITLE

PLAN LAYOUT OF KRUISFONTEIN SUBSTATION AND ASSOCIATED 22kV UNDERGROUND CABLE AND OVERHEAD LINE WORK, SCHEMATIC DIAGRAM AND DETAILS

DRAWN	DESIGNED	CHECKED	APPROVED
MVM	GSA	GSA	

SCALE	DATE	CAD REF No.	DWG-SIZE
AS SHOWN	16/04/2021	10518-E-01	A1

DRAWING NO.

10518/E/01

REVISION